# Type 3730-3 Electropneumatic Positioner with HART® communication



#### **Application**

Single-acting or double-acting positioner for attachment to pneumatic control valves. Self-calibrating, automatic adaptation to valve and actuator.

Set point 4 to 20 mA
Valve travel 3.6 to 300 mm
Opening angle 24 to 100°



The positioner ensures a predetermined assignment of the valve position (controlled variable x) to the input signal (set point w). It compares the input signal received from a control system to the travel or rotational angle of the control valve and issues a corresponding output signal pressure (output variable y).

#### Special features

- Simple attachment to all common linear and rotary actuators
  - SAMSON direct attachment (Fig. 1)
  - NAMUR rib (Fig. 2)
  - Attachment to rod-type yokes acc. to IEC 60534-6-1
  - Attachment according to VDI/VDE 3847
  - Rotary actuator attachment according to VDI/ VDE 3845 (Fig. 3)
- Any desired mounting position of the positioner (but not suspended)
- Simple single-knob, menu-driven operation
- LCD easy to read in any mounted position due to selectable reading direction
- Configurable with a PC over the SSP interface using the TROVIS-VIEW software
- Variable, automatic start-up with four different initialization modes
- Preset parameters only values deviating from the standard need to be adjusted
- Calibrated travel sensor without gears susceptible to wear
- Sub initialization mode (substitution) allows the positioner to be started up in case of emergency whilst the plant is running without the valve moving through the whole travel range.
- Permanent storage of all parameters in EEPROM (protected against power failure)
- Two-wire system with a small electrical load of 410  $\Omega$
- Adjustable output pressure limitation
- Activatable tight-closing function
- Continuous monitoring of zero point
- Integrated temperature sensor and operating hours counter



- Two standard programmable position alarms
- Self-diagnostics; alarms as condensed state conforming to NAMUR Recommendation NE 107, issued over a fault alarm contact or optional analog position transmitter
- Integrated EXPERTplus diagnostics for control valves
   T 8389)

flow Valve

#### **Versions**

- Type 3730-3 · Electropneumatic positioner for control valves, on-site operation, local communication with SSP interface, EXPERTplus diagnostics, HART® communication
- Type 3730-6 · Electropneumatic positioner for control valves, HART® communication, on-site operation, local communication with SSP interface, EXPERTplus diagnostics, pressure sensors to monitor the supply air and signal pressure > T 8384-6

### Additional options

- Inductive limit contact with proximity switches
- Analog position transmitter with two-wire transmitter
- Forced venting function with solenoid valve
- Binary input
- External position sensor (Fig. 4)
- Analog input x
- Stainless steel housing
- Leakage sensor to monitor the seat leakage

#### Principle of operation

The positioner is mounted on pneumatic control valves and is used to assign the valve position (controlled variable x) to the control signal (set point w). The positioner compares the electric control signal of a control system to the travel or rotational angle of the control valve and issues a signal pressure (output variable y) for the pneumatic actuator.

The positioner mainly consists of an electric travel sensor system (2), an analog i/p module with a downstream air capacity booster and the electronics with the microcontroller (5). When a set point deviation occurs, the actuator is either vented

When a set point deviation occurs, the actuator is either vented or filled with air. If necessary, the signal pressure change can be slowed down with a volume restriction that can be connected as necessary. The signal pressure to the actuator can be limited by software to 1.4, 2.4 or 3.7 bar.

A constant air stream with a fixed set point to the atmosphere is created by flow regulator (9) with a fixed set point. The i/p module (6) is supplied with a constant upstream pressure by the pressure regulator (8) to compensate for any fluctuations in the supply pressure.

#### Operation


The positioner is operated with a user-friendly rotary pushbutton. The parameters are selected by turning the knob, pushing it activates the required setting. In the menu, all parameters are listed in one level, eliminating the need to search in submenus. All parameters can be checked and changed on site.

All values are displayed on the LCD. The reading direction of the LCD can be rotated by 180°.

The closing direction of the control valve is indicated to the positioner by setting the slide switch "Air to open/Air to close". It assigns the CLOSED position of the control valve to the 0 % reading.

The INIT key activates initialization which is started according to the ready adjusted parameters (autotune). After initialization is completed, the positioner immediately starts closed-loop operation.

To configure the positioner with SAMSON's TROVIS-VIEW software, the positioner is equipped with an additional digital interface to be connected to the RS-232 or USB interface of a PC. All parameters can be accessed using HART® communication.

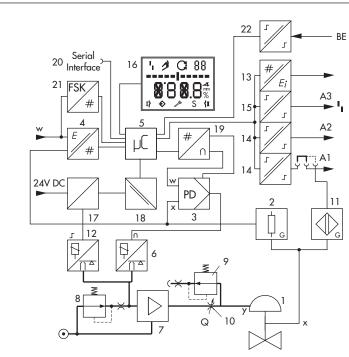

- 1 Control valve
- 2 Travel sensor
- 3 Controller
- 4 A/D converter
- 5 Microcontroller
- 6 i/p module
- 7 Booster
- 8 Pressure regulator
- 9 Flow regulator
- 10 Volume restriction
- 11 Inductive limit contact (option)
- 12 Solenoid valve (option)
- 13 Position transmitter or binary input (option)
- 14 Software limit contacts
- 15 Fault alarm output
- 16 Display
- 17 Actuation of solenoid valve
- 18 Galvanic isolation (option)
- 19 D/A converter
- 20 Communication interface
- 21 HART® connection
- 22 Binary input BE (option)

Fig. 5: Functional diagram of Type 3730-3 Positioner

Table 1: Technical data for Type 3730-3 Positioner

Type 3730-3 l	Positioner	The technical data for the explosion-protected devices may be restricted by the limits specified in the test certificates.										
Valve travel Adjustable		Direct attachment to Type 3277 Actuator	3.6 to 30 mm									
		Attachment according to IEC 60534-6 (NAMUR)	3.6 to 300 mm									
		Attachment according to VDI/VDE 3847	3.6 to 300 mm									
		Attachment to rotary actuators (VDI/VDE 3845)	24 to 100° opening angle									
Travel range	Adjustable	Adjustable within the initialized travel/angle of rotation of the valve; travel can be restricted to 1/5 at the maximum.										
C-1 '-1 -	Signal range	4 to 20 mA · Two-wire device, reverse polarity protection Minimum span 4 mA										
Set point w	Static destruction limit	100 mA										
Minimum curr	ent	3.6 mA for display · 3.8 mA for operation										
Load impedan	ice	$\leq$ 8.2 V (corresponds to 410 $\Omega$ at 20 mA)										
Supply pressure		1.4 to 7 bar (20 to 105 psi)										
Supply air	Air quality acc. to ISO 8573-1	Max. particle size and density: Class 4 · Oil content: Class K below the lowest ambient temperature to be expected	s 3 · Pressure dew point: Class 3 or at least 10									
Signal pressur	re (output)	0 bar up to the capacity of the supply pressure · Can be by software	limited to $1.4  \text{bar}/2.4  \text{bar}/3.7  \text{bar} \pm 0.2  \text{bar}$									
Characteristic	Adjustable	Linear/equal percentage/reverse equal percentage User-defined (over operating software and communication Butterfly valve, rotary plug valve and segmented ball valve	on) ve: linear/equal percentage									
	Deviation	≤1 %										
Hysteresis		≤0.3 %										
Sensitivity		≤0.1 %										
Transit time		Venting or filling with air adjustable separately up to 240 s by software										
Direction of a	ction	Reversible										
Air consumption	on, steady state	Independent of supply air approx. 110 l <sub>n</sub> /h										
Air output	to fill actuator with air	At $\Delta p = 6$ bar: $8.5 \text{ m}_n^3/\text{h}$ · At $\Delta p = 1.4$ bar: $3.0 \text{ m}_n$	$_{n}^{3}/h \cdot K_{V_{max}(20  ^{\circ}C)} = 0.09$									
capacity	to vent actuator	At $\Delta p = 6$ bar: 14.0 m <sub>n</sub> <sup>3</sup> /h · At $\Delta p = 1.4$ bar: 4.5 m <sub>r</sub>										
Permissible an	nbient temperature	-20 to +80 °C (all versions) -45 to +80 °C with metal cable gland The temperature limits for the explosion-protected device specified in the test certificates.	ces may be further restricted by the limits									
	Temperature	≤0.15 %/10 K										
Influences	Supply air	None										
	Effect of vibration	≤0.25 % up to 2000 Hz and 4 g according to IEC 770										
Electromagnet	ic compatibility	Complying with EN 61000-6-2, EN 61000-6-3, EN 613	326-1 and NAMUR Recommendation NE 21									
Electrical conn	. ,	One M20x1.5 cable gland for 6 to 12 mm clamping range Second M20x1.5 threaded connection additionally available Screw terminals for 0.2 to 2.5 mm² wire cross-section										
Degree of pro	tection	IP 66/NEMA 4X										
Use in safety-i (SIL)	nstrumented systems	Observing the requirements of IEC 61508, the systematic capability of the pilot valve for emergency venting as a component in safety-instrumented systems is given.										
	nting at 0 mA set point ional solenoid valve	Use is possible on observing the requirements of IEC 615 in safety-instrumented systems up to SIL 2 (single device/HFT = 1).										
Explosion protection		See Table 3										
Communication (local)		SAMSON SSP interface and serial interface adapter										
Software requ	irements (SSP)	TROVIS-VIEW with database module 3730-3										
Communication	on (HART®)	HART® field communication protocol Impedance in HART® frequency range: Receiving 350 to	450 Ω · Sending approx. 115 Ω									
Software requirements	For handheld communicator	Device description for Type 3730-3										
(HART®)	For PC	DTM file according to specification 1.2, suitable for integral support the use of FDT/DTM (e.g. PACTware); other integral.										
Compliance		C € [R[										

Binary conta	cts							
For connection	on to	Binary input of a PLC acc. to IEC 61131-2  P <sub>max</sub> = 400 mW or for connection to NAMUR switching amplifier acc. to EN 60947-5-6	NAMUR switching amplifier acc. to EN 60947-5-6					
Two software	limit contacts, reverse	polarity protection, floating, configurable switching characteristi	cs (default settings in table below)					
Signal state	Version	No explosion protection	Ex					
	No response	Effectively non-conducting	≤1.0 mA					
	Response	Conductive (R = 348 Ω)	≥2.2 mA					
One fault ala	rm contact							
	Version	No explosion protection	Ex					
Signal state	No fault alarm	Conductive (R = $348 \Omega$ )	≥2.2 mA					
	Fault alarm	Effectively non-conducting	≤1.0 mA					
Materials								
Housing		Die-cast aluminum EN AC-AlSi12(Fe) (EN AC-44300) acc paint coated · Special version: stainless steel 1.4581	t. to DIN EN 1706 · Chromated and powder					
External parts	s	Stainless steel 1.4404/316L						
Cable gland		M20 x 1.5, black polyamide						
Weight		Die-cast aluminum housing: approx. 1.0 kg Stainless steel housing: approx. 2.2 kg						

**Table 2:** Options for Type 3730-3 Positioner

Solenoid valve · Approval acc. to IEC &	51508/SIL
Input	24 V DC · Galvanically isolated and reverse polarity protection · Static destruction limit 40 V
	Current consumption I = $\frac{U - 5.7 \text{ V}}{3840 \Omega}$ (corresponding to 4.8 mA at 24 V/114 mW)
Signal '0' (no response)	<12 V (emergency venting at 0 V)
Signal '1' (response)	>19 V
Service life	>5 x 10 <sup>6</sup> switching cycles
K <sub>V</sub> coefficient	0.15
Analog position transmitter	Two-wire transmitter · Galvanically isolated
Supply air	12 to 30 V DC · Reverse polarity protection · Static destruction limit 40 V
Output signal	4 to 20 mA
Operating direction	Reversible
Operating range	-10 to +114 %
Characteristic	Linear
Hysteresis	Same as positioner
High-frequency influence	Same as positioner
Other influences	Same as positioner
Fault alarm	Issued as status current 2.4 ±0.1 mA or 21.6 ±0.1 mA
Pepperl+Fuchs inductive limit contact	For connection to switching amplifier according to EN 60947-5-6.  Can be used in combination with a software limit contact.
SJ2-SN proximity switch	Measuring plate not detected: ≥3 mA · Measuring plate detected: ≤1 mA
External position sensor	
Valve travel	Same as positioner
Cable	10 m · Flexible and durable · With M12x1 connector · Flame-retardant acc. to VDE 0472 Resistant to oils, lubricants and coolants as well as other aggressive media
Permissible ambient temperature	$-40$ to $+90$ °C with a fixed connection between positioner and position sensor $\cdot$ The limits in the test certificate additionally apply for explosion-protected versions
Immunity to vibration	Up to 10 g in the range of 10 to 2000 Hz
Degree of protection	IP 67
<b>Leakage sensor</b> · Suitable for operation	n in hazardous areas
<b>Leakage sensor</b> · Suitable for operation Temperature range	n in hazardous areas -40 to +130 °C

Binary input · C	Galvanically isolated · Sv	vitching behavior configured over software (e.g. TROVIS-VIEW, DTM)
Active switching	behavior (default settin	g)
Connection		For external switch (floating contact) or relay contact
Electric data		Open-circuit voltage when contact is open: max. 10 V Pulsed DC current reaching peak value of 100 mA and RMS value of 0.01 mA when contact is closed
Contact	Closed, R < 20 $\Omega$	ON switching state (default setting)
	Open, R > 400 Ω	OFF switching state (default setting)
Passive switching	g behavior	
Connection		For externally applied DC voltage, reverse polarity protection
Electric data		3 to 30 V · Static destruction limit 40 V · Current consumption 3.7 mA at 24 V
Voltage >6 V		ON switching state (default setting)
Voltage —	<1 V	OFF switching state (default setting)
Analog input x	· Galvanically isolated ·	Input for externally measured valve position
Input signal		4 to 20 mA · Reverse polarity protection · Minimum span 6.4 mA
Electric data		Load impedance at 20 mA: 6.0 V $\cdot$ Impedance at 20 mA: 300 $\Omega$ $\cdot$ Overload capacity: 24 V AC/DC

 Table 3: Explosion protection certificates

Ту	ре	Certification			Type of protection/comments
ဇှ		INMETRO	Number Date Valid until	IEx 13.0161 2016-08-29 2019-08-28	Ex ia IIC T* Gb
		STCC	On request		
		EC type examination certificate	Number Date	PTB 02 ATEX 2174 2017-02-14	II 2 G Ex ia IIC Gb; II 2 D Ex ia IIIC T80°C Db
		ERC Ex	Number Date Valid until	RU C-DE08.B.00113 2013-11-15 2018-11-14	1Ex ia IIC T6/T5/T4 Gb X; Ex tb IIIC T80°C Db X
	-31	IECEx	Number Date	IECEx PTB 05.0008X 2016-11-30	Ex ia IIC T6-T4 Gb; Ex ia IIIC T80°C Db
3730	•	ССоЕ	Number Date Valid until	A/P/HQ/MH/104/1166 2016-07-23 2021-07-22	Ex ia IIC T6
		KCS	Number Date Valid until	11-KB4BO-0224 2011-11-10 2017-11-10	Ex ia IIC T6/T5/T4
		NEPSI	On request		
	-33	CSA	Number Date	1330129 2017-05-24	Ex ia IIC T6; Class I, Zone 0; Class I, Groups A, B, C, D; Class II, Groups E, F, G; Class I, Zone 2; Class I, Div.2, Groups A, B, C, D; Class II, Div.2, Groups E, F, G
		FM	Number Date	3012394 2011-08-11	Class I, Zone O AEx ia IIC; Class I, II, III; Div. 1, Groups A, B, C, D, E, F, G; Class I, Div. 2, Groups A, B, C, D; Class II, III. Div. 2, Groups F, G

Ту	ре	Certification			Type of protection/comments
	-35	EC type examination certificate	Number Date	PTB 02 ATEX 2174 2017-02-14	II 2 D Ex th IIIC T80°C Dh
		IECEx	Number Date	IECEx PTB 05.0008X 2016-11-30	Ex ia IIIC T80°C Db
3730		Statement of conformity	Number Date	PTB 03 ATEX 2180 X 2016-06-30	II 3G Ex nA II T6 Gc, II 3D Ex tc IIIC T80°C Db
8	-38	EHC Ex	Number Date Valid until	RU C-DE08.B.00113 2013-11-15 2018-11-14	2Ex nA IIC T6/T5/T4 Gc X; 2Ex ic IIC T6/T5/T4 Gc X; Ex tc IIIC T80°C Dc X
		IECEx	Number Date	IECEx PTB 05.0008X 2016-11-30	Ex nA IIC T6 Gc, Ex tc IIIC T80°C Dc
		NEPSI	On request		

The test certificates are included in the mounting and operating instructions or are available on request. Refer to Data Sheet ▶ T 8379 for Ex d approvals of Type 3770 Field Barrier

## Mounting the positioner


The Type 3730 Electropneumatic Positioner can be attached directly to the Type 3277 Actuator (175 to 750 cm²) over a connection block. In actuators with "actuator stem extends" fail-safe action, the signal pressure is routed over an internal hole in the actuator yoke to the actuator. In actuators with "actuator stem retracts" fail-safe action, the signal pressure is routed to the actuator over ready-made external piping.


Using the appropriate bracket, the positioner can also be attached according to IEC 60534-6-1 (NAMUR recommendation). The positioner can be mounted on either side of the control valve.


A pair of universal brackets is used for the attachment to Type 3278 Rotary Actuators or other rotary actuators according to VDI/VDE 3845. The rotary motion of the actuator is transferred to the positioner over a coupling wheel with travel indication.

A special version of the positioner allows it to be attached according to VDI/VDE 3847. This type of attachment allows the positioner to be replaced quickly while the process is running by blocking the air in the actuator. The positioner can be attached directly to the Type 3277 Actuator using an adapter bracket or adapter block. Alternatively, it can be attached to the NAMUR rib of a control valve using an additional NAMUR connection block.

A reversing amplifier is necessary for double-acting, springless actuators for the second opposing signal pressure.

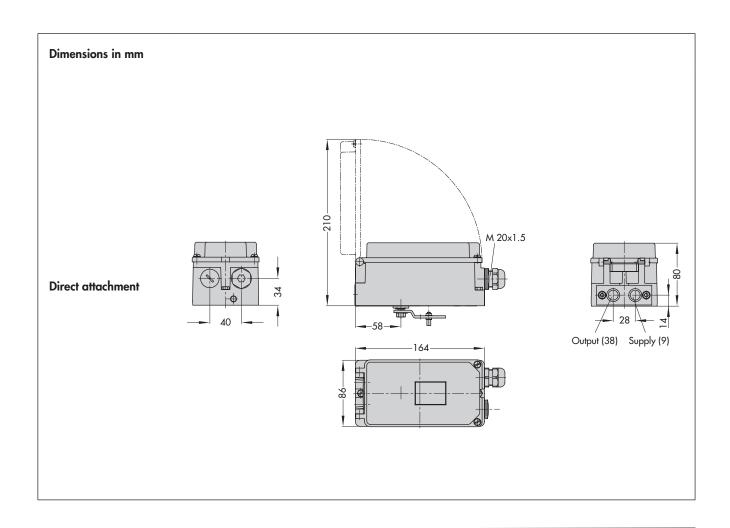

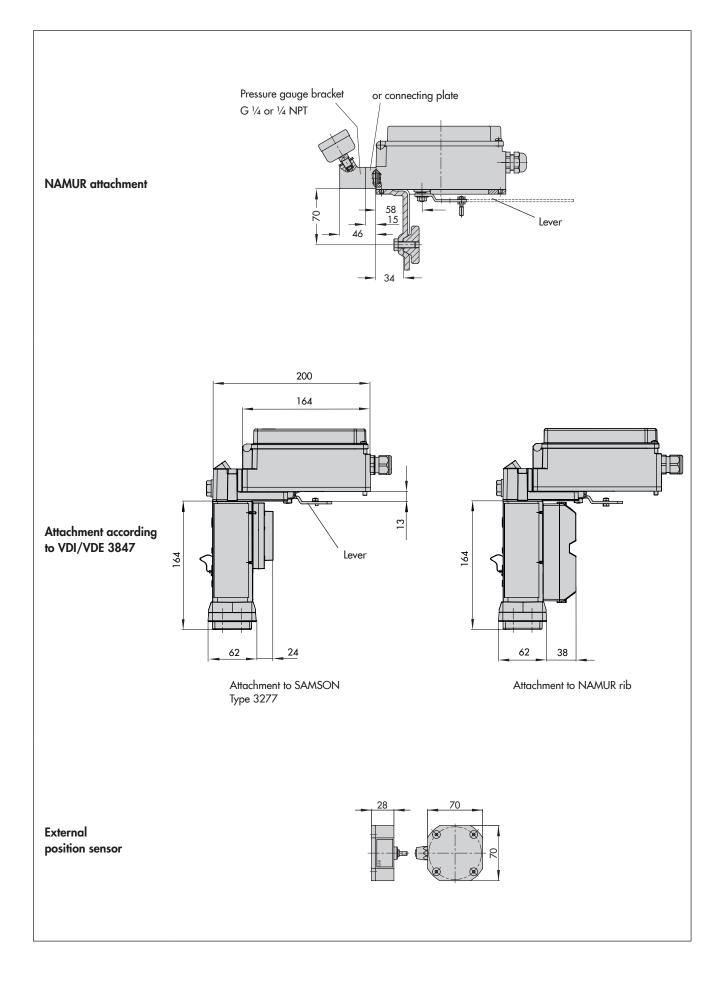

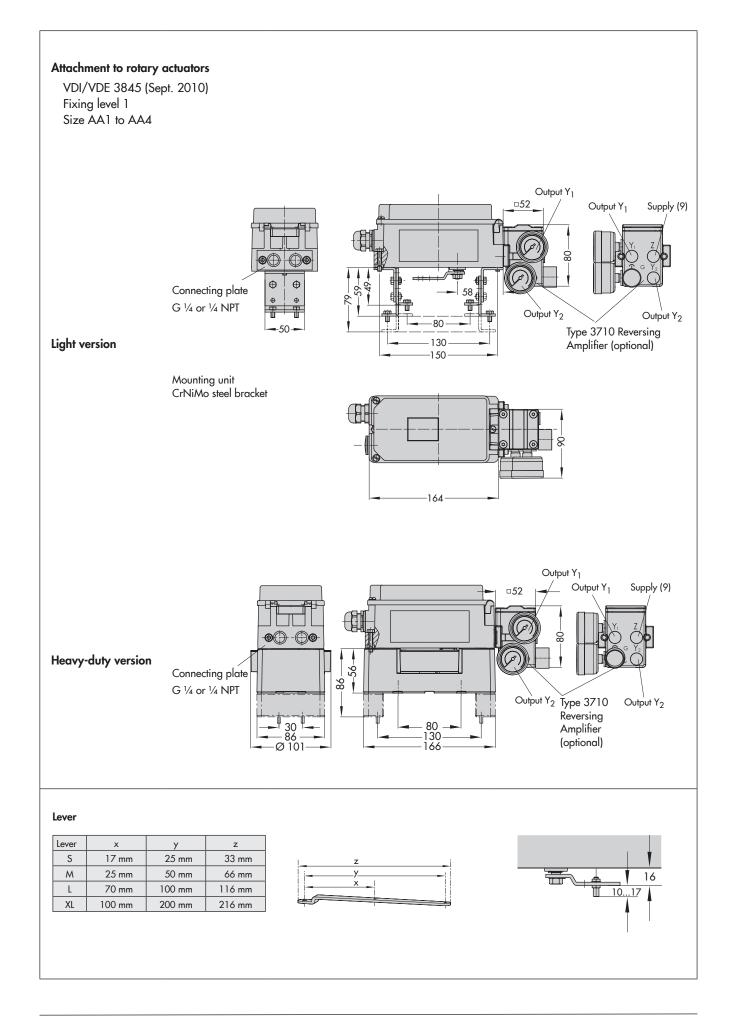

# Ordering text

Type 3730-3... Positioner

- Without pneumatic connecting rail (only when directly attached to Type 3277)
- With pneumatic connecting rail ISO 228/1-G ¼
- With pneumatic connecting rail 1/4-18 NPT
- Without/with pressure gauge up to max. 6 bar
- Attachment to Type 3277 Actuator (175 to 750 cm²)
- Attachment according to IEC 60534-6-1 (NAMUR)
   Valve travel: ... mm, if applicable, rod diameter: ... mm
- Attachment according to VDI/VDE 3847
   Valve travel: ... mm, if applicable, rod diameter: ... mm
- Attachment to Type 3278 Rotary Actuator (160/320 cm²), mounting unit with CrNiMo steel bracket or heavy-duty attachment
- Attachment to rotary actuators acc. to VDI/VDE 3845, mounting unit with CrNiMo steel bracket or heavy-duty attachment
- Pneumatic reversing amplifier for double-acting actuators with connection acc. to ISO 228/1-G ¼ or ¼-18 NPT
- Adapter M20x1.5 to ½ NPT
- Metal cable gland
- Special version: housing made of CrNiMo steel

# Article code

Article co	ode															
Positioner	Type 3730-3	х	хх	(	x	х	х	Х	( )	x (	) >	0	0	х (	) x	(
With LCD	and autotune, HART® communication, 4 to 20 mA					Τ										
two sof	ftware limit contacts, one fault alarm contact		Ш													
Explosion	protection															
Withou	ut	0														
ATEX	II 2 G Ex ia IIC Gb; II 2 D Ex ia IIIC T80°C Db	1														
CSA	Ex ia IIC T6; Class I, Zone 0; Class I, Groups A, B, C, D; Class II, Groups E, F, G; Class I, Zone 2; Class I, Div.2, Groups A, B, C, D; Class II, Div.2, Groups E, F, G	3														
FM	Class I, Zone O AEx ia IIC; Class I, II, III; Div. 1, Groups A, B, C, D, E, FG; Class I, Div. 2, Groups A, B, C, D; Class II, III. Div. 2, Groups F, G	,														
ATEX	II 2 D Ex tb IIIC T80°C Db	5														
ATEX	II 3G Ex nA II T6 Gc, II 3D Ex tc IIIC T80°C Db	8														
Option (a	additional equipment)															
Inductiv	ve limit contact															
With	nout		0													
SJ2-	SN (NC contact)		1													
Soleno	id valve		$\lceil \rceil$													
With	nout		d	)												
With	n, 24 V DC		4	1												
	n transmitter			_												
With	nout				0											
With	1				1	Ó	0	Ċ	)							
Externo	al position sensor															
With		Ì				Ó										
With	1		0			1					(	)				
Prep	pared connection		0			2										
	log input x	Ó	0		0	3	0	Ċ	)							
	ge sensor						-									
With							0									
With	1				0	0	1	Ċ	)							
Binary	input							_								
With								Ċ	)							
With	1				0	0	0	2	2							
Diagnosti	ics															
EXPERT									_	4						
Housing r																
_	num (standard)										(	)				
	ss steel 1.4581				0						1					
	pplication															
Withou														0		
	completely free of paint-impairing substances													1		
	st air with ¼ NPT connection, back of housing sealed													2		
	ment according to VDI/VDE 3847 including interface													6		
	ment according to VDI/VDE 3847 prepared for interface													7		
Special ve																
Withou															0	)
	Ex ia IIC T6-T4 Gb; Ex ia IIIC T80°C Db	1													1	
LULA	Ex tb IIIC T80°C Db	5													3	2
															1	,
	Ex nA IIC T6 Gc, Ex tc IIIC T80°C Dc	8													1	
EAC =	- 1E. : IIC T4 /TE /T4 Ch V. E IIIC T00°C Ch V	1														
EAC Ex	<ul> <li>1Ex ia IIC T6/T5/T4 Gb X; Ex tb IIIC T80°C Db X</li> <li>2Ex nA IIC T6/T5/T4 Gc X; 2Ex ic IIC T6/T5/T4 Gc X;</li> </ul>	1 8													2	2

Specifications subject to change without notice

